

Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 137

Dated: 27/5/26

It is certified that an inspection team headed by Siddharth Bhardwaj

(Name of Officers with designation) from Assistant Engineer PHED

inspected the Abhyuday International School, Dinara (Rohas)

(Name & Address of the school) on 25/05/2026 (date of inspection) and on the basis of
Water Test Report (Attached) bearing no. S.R.M./W/2026-27/R/12 dated 27/05/2026

of One Year (PHED Lab) certified that

the Abhyuday International School (Name of school) has safe drinking water
facilities for the students and members of staff of the institution. School is also maintains the
hygienic sanitation condition in the school building & the campus as per norms prescribed by the
Central/ State/ U.T. Govt.

This certificate is valid till 26/05/2027.

Signature with Seal: Siddharth Bhardwaj

Name


Designation

Name & Address of the Office/ Department: PHED

To

Director
Abhyuday International School, Dinara
(Name & Address of the Institution)

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies

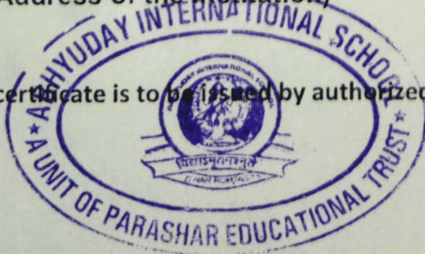



TC-14408

District Level Laboratory PHED, Sasaram, Rohtas
Old G.T. Road, Near Railway Station, Sasaram, (Rohtas)
eephedrohtas@gmail.com Ph.No :- 8544428572/8544428639



बिहार सरकार

TEST REPORT

Name & Address Of the Customer:- ABHYUDAY INTERNATIONAL SCHOOL, DINARA "A UNIT OF PARASHAR EDUCATION TRUST "	Report No.	: SRM/W/2026-27/R/ 12
	Date	: 27/05/2026
	Sample No.	: SRM/W/26-27/12
	Sample Description	: Drinking Water
	Sample Mark/ Location	: ABHYUDAY INTERNATIONAL
	Sample Collected On	: 22/05/2026
	Sampling Plan & Method	: IS 3025(Part 1)
	Date of Performance (s)	: 22/05/2026 to 27/05/2026
	Ref No. Date	:

Analysis Result

Sl. No.	Test Parameter	Test Method	IS 10500:2012Amd. 1 & 2		Result
			Acceptable Limit	Permissible Limit	
1	pH	IS 3025(Part 11) : 2022	6.5-8.5	NR	7.59
2	Turbidity	IS 3025(Part 10) : 2023	1 NTU	5 NTU	1
3	TDS	IS 3025(Part 16) : 2023	500 mg/ L	2000 mg/ L	343
4	Total Hardness	IS 3025(Part 21) : 2019	200 mg/ L	600 mg/ L	240
5	Calcium	IS 3025(Part 40) : 2023	75 mg / L	200 mg/L	38
6	Magnesium	APHA 24rd Edition -3500-Mg Method B (Calculation Method) : 2023	30 mg /L	100 mg/ L	35.23
7	Iron	APHA 23rd Edition -3500-Fe Method B (Phenanthroline Method) : 2023	1 mg/ L	NR	0.1
8	Chloride	IS 3025(Part 32) : 2019	250 mg/ L	1000 mg / L	32
9	Total Alkalinity	IS 3025(Part 23) : 2023	200 mg / L	600 mg / L	280
10	Fluoride	APHA 23rd Edition -4500-F Method C (Electrode Method) : 2023	1 mg / L	1.5 mg / l	0.134
11	Colour	IS 3025 (Part 4) : 2021	5	15	<1
12	Odour	IS 3025 (Part 5) : 2022	Agreeable	Agreeable	Agreeable
13	Taste	IS 3025 (Part 8) : 2023	Agreeable	Agreeable	Agreeable

Reviewed

R. Kumar
27/05/2026

Chemist

D.L.L Sasaram, Rohtas

Authorized

P. K. Singh
27/05/2026

Technical Manager

D.L.L Sasaram, Rohtas

Disclaimer:

- The result relates only to the items(S) tested
- The report shall not be reproduced except in full, without approval of the laboratory
- The reserved part of water samples (s) shall be retained for 15 Days from the date of issue of the test Report.
- The laboratory is responsible for all the information given in the report.